



Report of Compressive Strength and Absorption

Client: AHI Supply, Inc.
Project: Quality Control Testing
Project No: 101029

Report No.: 13391
Date of Service: 06/13/19
Report Date: 06/13/19
P.O. No.: C31677


Sample ID: Week 21, Line LUIS
Manufacture Date: 05/16/2019
ASTM C 1194, Compressive Strength of Architectural Cast Stone

Sample No.	Width (in.)	Width (in.)	Area (Sq. In.)	Load (lbf)	Compressive Strength (PSI)
1	1.97	2.04	4.02	37,930	9,440
2	1.97	2.02	3.98	46,010	11,560
3	1.98	2.03	4.02	47,810	11,890
Average					10,960

ASTM C 1195, Absorption of Architectural Cast Stone

Sample ID	Oven Dry Weight (g)	SSD Weight (g)	Absorption (percent)
A	264.10	269.09	1.89
B	271.18	276.12	1.82
C	277.72	282.57	1.75
Average			1.82

Technician: J.Halverson

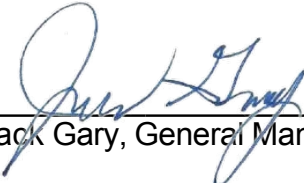

Jack Gary, General Manager