



## Report of Compressive Strength and Absorption

**Client:** AHI Supply, Inc.  
**Project:** Quality Control Testing  
**Project No:** 101029

**Report No.:** 13391  
**Date of Service:** 06/13/19  
**Report Date:** 06/13/19  
**P.O. No.:** C31677

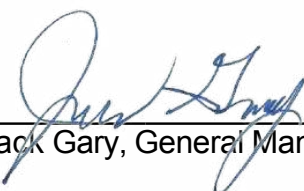
**Sample ID:** Week 21, Line LUIS  
**Manufacture Date:** 05/16/2019  
 ASTM C 1194, Compressive Strength of Architectural Cast Stone

Sample No.	Width (in.)	Width (in.)	Area (Sq. In.)	Load (lbf)	Compressive Strength (PSI)
1	1.97	2.04	4.02	37,930	9,440
2	1.97	2.02	3.98	46,010	11,560
3	1.98	2.03	4.02	47,810	11,890
<b>Average</b>					<b>10,960</b>

ASTM C 1195, Absorption of Architectural Cast Stone

Sample ID	Oven Dry Weight (g)	SSD Weight (g)	Absorption (percent)
A	264.10	269.09	1.89
B	271.18	276.12	1.82
C	277.72	282.57	1.75
<b>Average</b>			<b>1.82</b>

Technician: J.Halverson

  
 Jack Gary, General Manager